



BASIC OPERATING INSTRUCTIONS

RHINO103 EXTINGUISHING PANEL RANGE


PRODUCT CODE
RHINO103

Level 1 Access

Allows SILENCE BUZZER operation only
CONTROLS ENABLED: Yellow LED Off

Level 2 Access

Allows full control
CONTROLS ENABLED: Yellow LED On

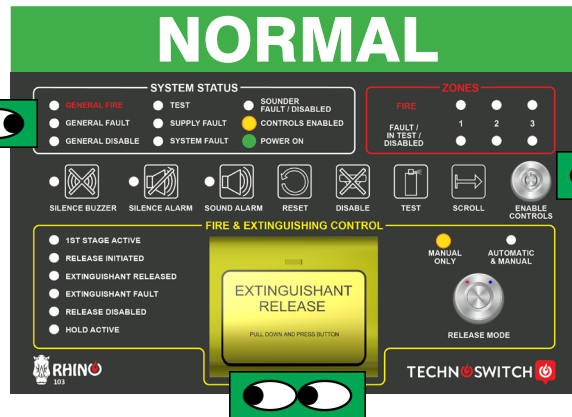

Extinguishing MCP

Manual release button (MCP)


Level Access Control Switch

Turn clockwise to access Level 2

Auto/Manual Key Switch

Turn the key to toggle between Manual and Auto & Manual modes.

- In MANUAL ONLY mode, the extinguishant can only be released via the yellow extinguishing MCP.
- In AUTOMATIC & MANUAL mode, the extinguishant will be released via the detection zones or the yellow extinguishing MCP.

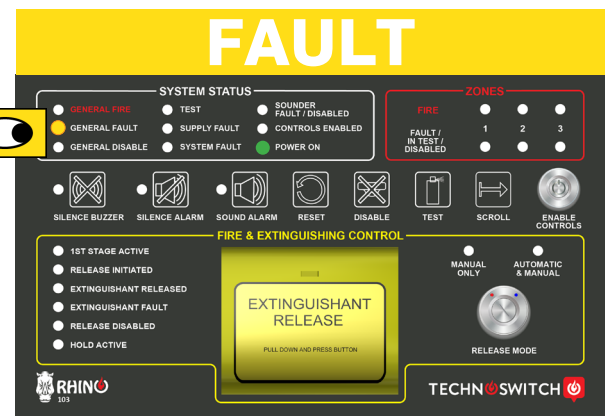

STEPS

NB: Controls must be enabled to perform SILENCE ALARM and RESET.

The extinguishant release sequence will vary depending on the configuration of the system.

- Press **SILENCE BUZZER**:
 - Internal buzzer will silence.
 - The SILENCE BUZZER's yellow LED will switch on.
- Press **SILENCE ALARM**:
 - If only 1st STAGE ACTIVE's red LED is on, then the sounders will silence.
 - The SILENCE ALARM's yellow LED will switch on.
 - If RELEASE INITIATED's red LED is on, the sounders will not silence until the discharge countdown is complete and the extinguishant is released.
- To pause the extinguishant release, a HOLD switch must be installed. If pressed during the released countdown, the HOLD ACTIVE yellow LED will switch on and the countdown will pause. The default EXT OUT Sounders tone will change when HOLD ACTIVE is on.
- To reset the system, press the RESET button and the panel will return to Normal state. Reset can only be performed if controls are enabled, and the system is not in RELEASE INITIATED mode or after a release in RESET INHIBIT mode.

STEPS

IF FAULT CONDITION

- Press **SILENCE BUZZER**.
 - Internal buzzer will silence.
 - The SILENCE BUZZER's yellow LED will switch on.
- Identify the FAULT condition on the panel's membrane by checking which other yellow LED is flashing.
- Contact your service provider.

EMERGENCY CONTACT DETAILS

SERVICE PROVIDER CONTACT DETAILS

DISCLAIMER: Although the contents of our product literature have been prepared with the greatest care, Technoswitch can accept no liability whatsoever for any direct or indirect damages of any kind that may arise due to either errors or omissions in them, or amendments to products or other specifications following publication.



HEAD OFFICE — JOHANNESBURG
Cussonia Park, 3 Ridge Road, Laser Park, Johannesburg T +27 (0)11 794 9144 E info@technoswitch.co.za
CAPE TOWN T +27 (0)21 948 4575 DURBAN T +27 (0)31 266 8843

www.technoswitch.co.za