




BASIC OPERATING INSTRUCTIONS ESPRIT INTELLIGENT FACP RANGE

NORMAL

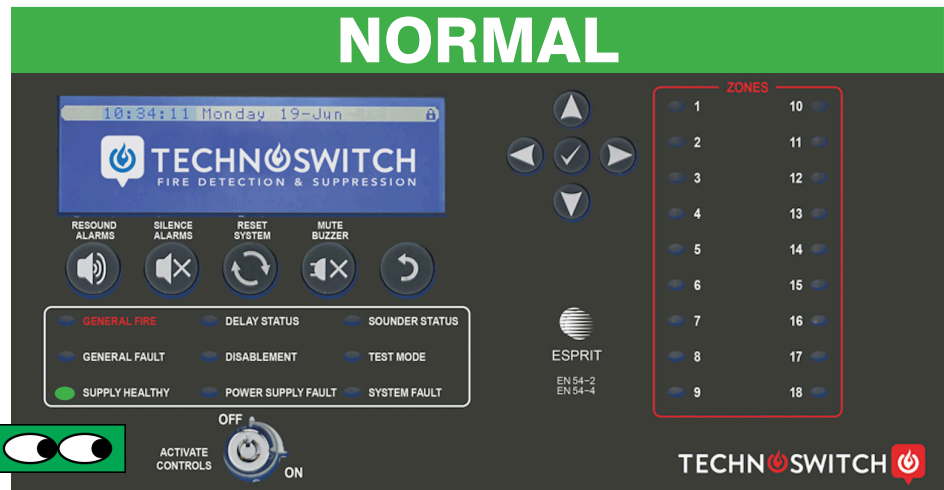

■ ACTIVATE CONTROLS

Key Switch

OFF: Allows MUTE BUZZER operation only

ON: Allows full control

FIRE



■ STEPS TO FOLLOW IF A FIRE ALARM IS ACTIVATED

NB: ACTIVATE CONTROLS must be switched to ON to perform SILENCE ALARMS and RESET.

1. Press MUTE BUZZER – The internal buzzer will silence.
2. Press SILENCE ALARMS – Sounders will silence and the FIRE LED will change from flashing to steady.

■ VERIFY FOR FIRE OR FALSE ALARM

IF FIRE ALARM

1. Press RESOUND ALARMS – Sounders will re-activate.
2. Contact Emergency Services.
3. Follow your standard evacuation procedure.


IF FALSE ALARM

Once the source of the false alarm has been cleared, press the RESET SYSTEM button, and the panel will return to its normal state.

■ STEPS TO FOLLOW IF A FAULT IS ACTIVATED

1. Press MUTE BUZZER – The internal buzzer will silence and FAULT LEDs will change from flashing to steady.
2. Identify the fault condition on the panel fascia
3. Contact your service provider.

FAULT

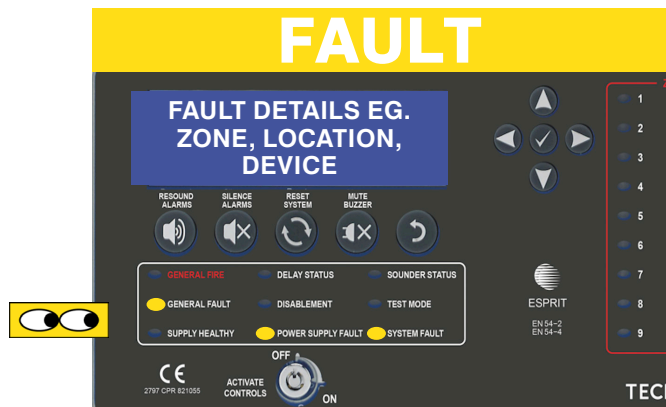

■ EMERGENCY CONTACT DETAILS

■ SERVICE PROVIDER CONTACT DETAILS

■ **DISCLAIMER:** Although the contents of our product literature have been prepared with the greatest care, Technoswitch can accept no liability whatsoever for any direct or indirect damages of any kind that may arise due to either errors or omissions in them, or amendments to products or other specifications following publication. E&OE